

# SPECIFICATIONS



<b>Model</b>	<b>OPA 465RKTB</b>
Configuration	Horizontal Supply Air
Item No. (Standard / Opposite Hand)	856-047-901 / 856-047-910
Cooling capacity (net) to AS/NZS 3823 T1	42.5 kW
Heating capacity H1	41.3 kW
Electrical input - cooling	14.5 kW
Electrical input - heating	12.1 kW
EER / AEER (cooling)	2.93 / 2.92
COP / ACOP (heating)	3.41 / 3.39
Unit Controller	UC8 (x2)
Refrigerant	R410A
Refrigerant Charge	8.8 kg/sys.
Compressor oil type	POE 32-3MAF (or equivalent)
Compressor type	fixed scroll (x2)
Power supply	3 ph. 400V ac 50Hz
Compressor (3ph.) run amps at rating cond.	9.6 A/ph. (x2)
Compressor overload setting	13 A (x2)
Compressor circuit breaker	25 A (x2)
Indoor fan motor size	3.0 kW
Indoor fan motor overload setting	6.5 A
Nominal air flow at rating conditions	2400 l/s
Indoor fan motor (3ph.) - full load	6 A/ph.
Outdoor fan motor (1ph.) - full load	3 A (x2)
Outdoor fan capacitor size	12 $\mu$ fd (x2)
Control circuit breaker (internal)	2 A
Auxiliary power outlet (1ph.) overload setting	10 A
Running amps (total system)	23 / 29 / 23 A
Max. running amps (total system)	31 / 37 / 31 A
Net weight	819 kg

## Accessories:


Filters - rated EU4/G4 disposable	019-400-010 (x2) 450x600x50 019-400-007 (x2) 600x600x50
-----------------------------------	--

## Optional Controls:

TZT-100 Room temperature controller	201-000-350
-------------------------------------	-------------



Refer to temperzone for other options.

# DIMENSIONS (mm)





Not to Scale

## OPA 465RKTB01 Standard Hand

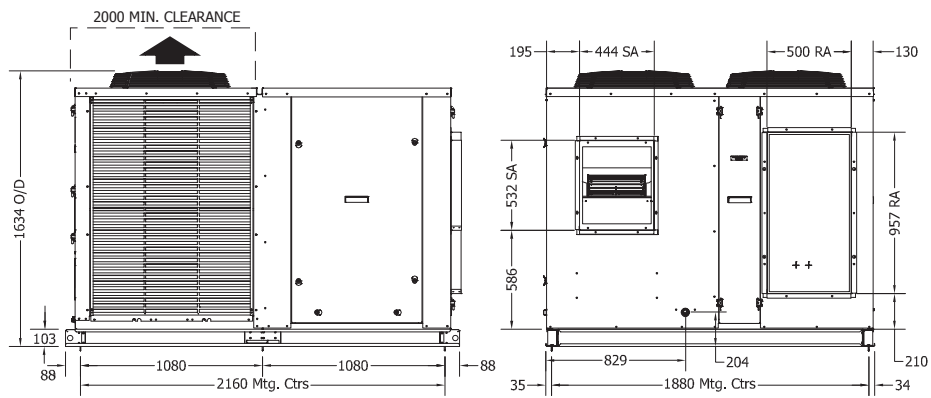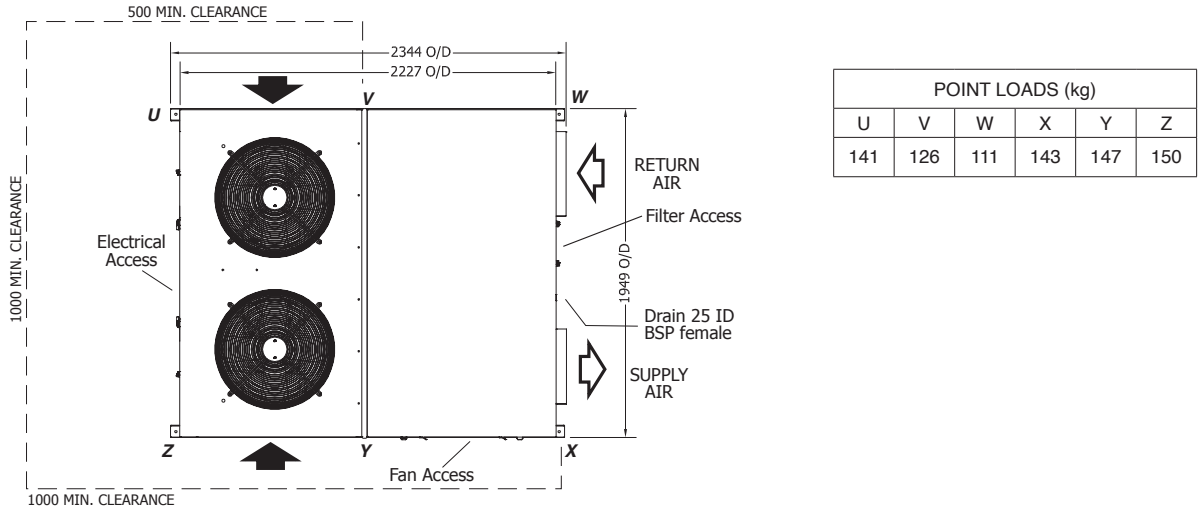


## OPA 465RKTB10 Opposite Hand

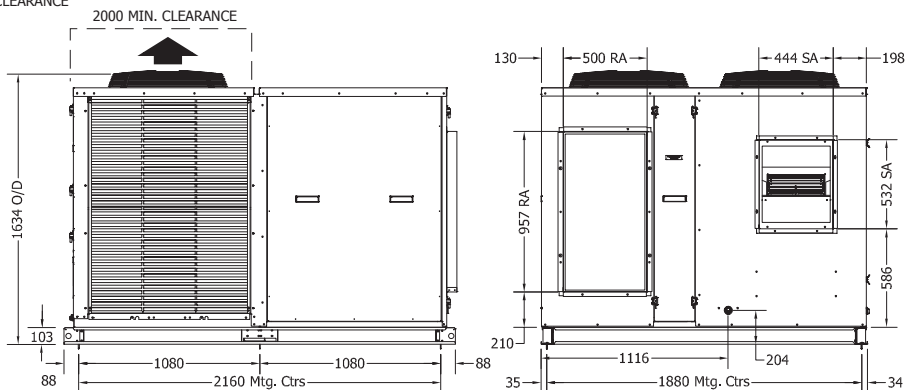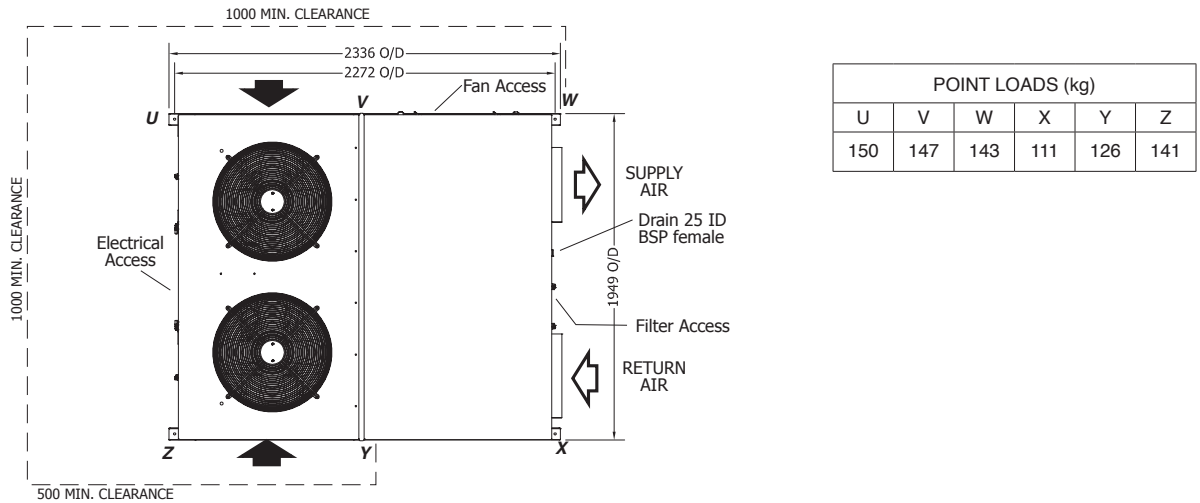

### NOTE

Specifications are subject to change without notice due to the manufacturer's ongoing research and development programme.



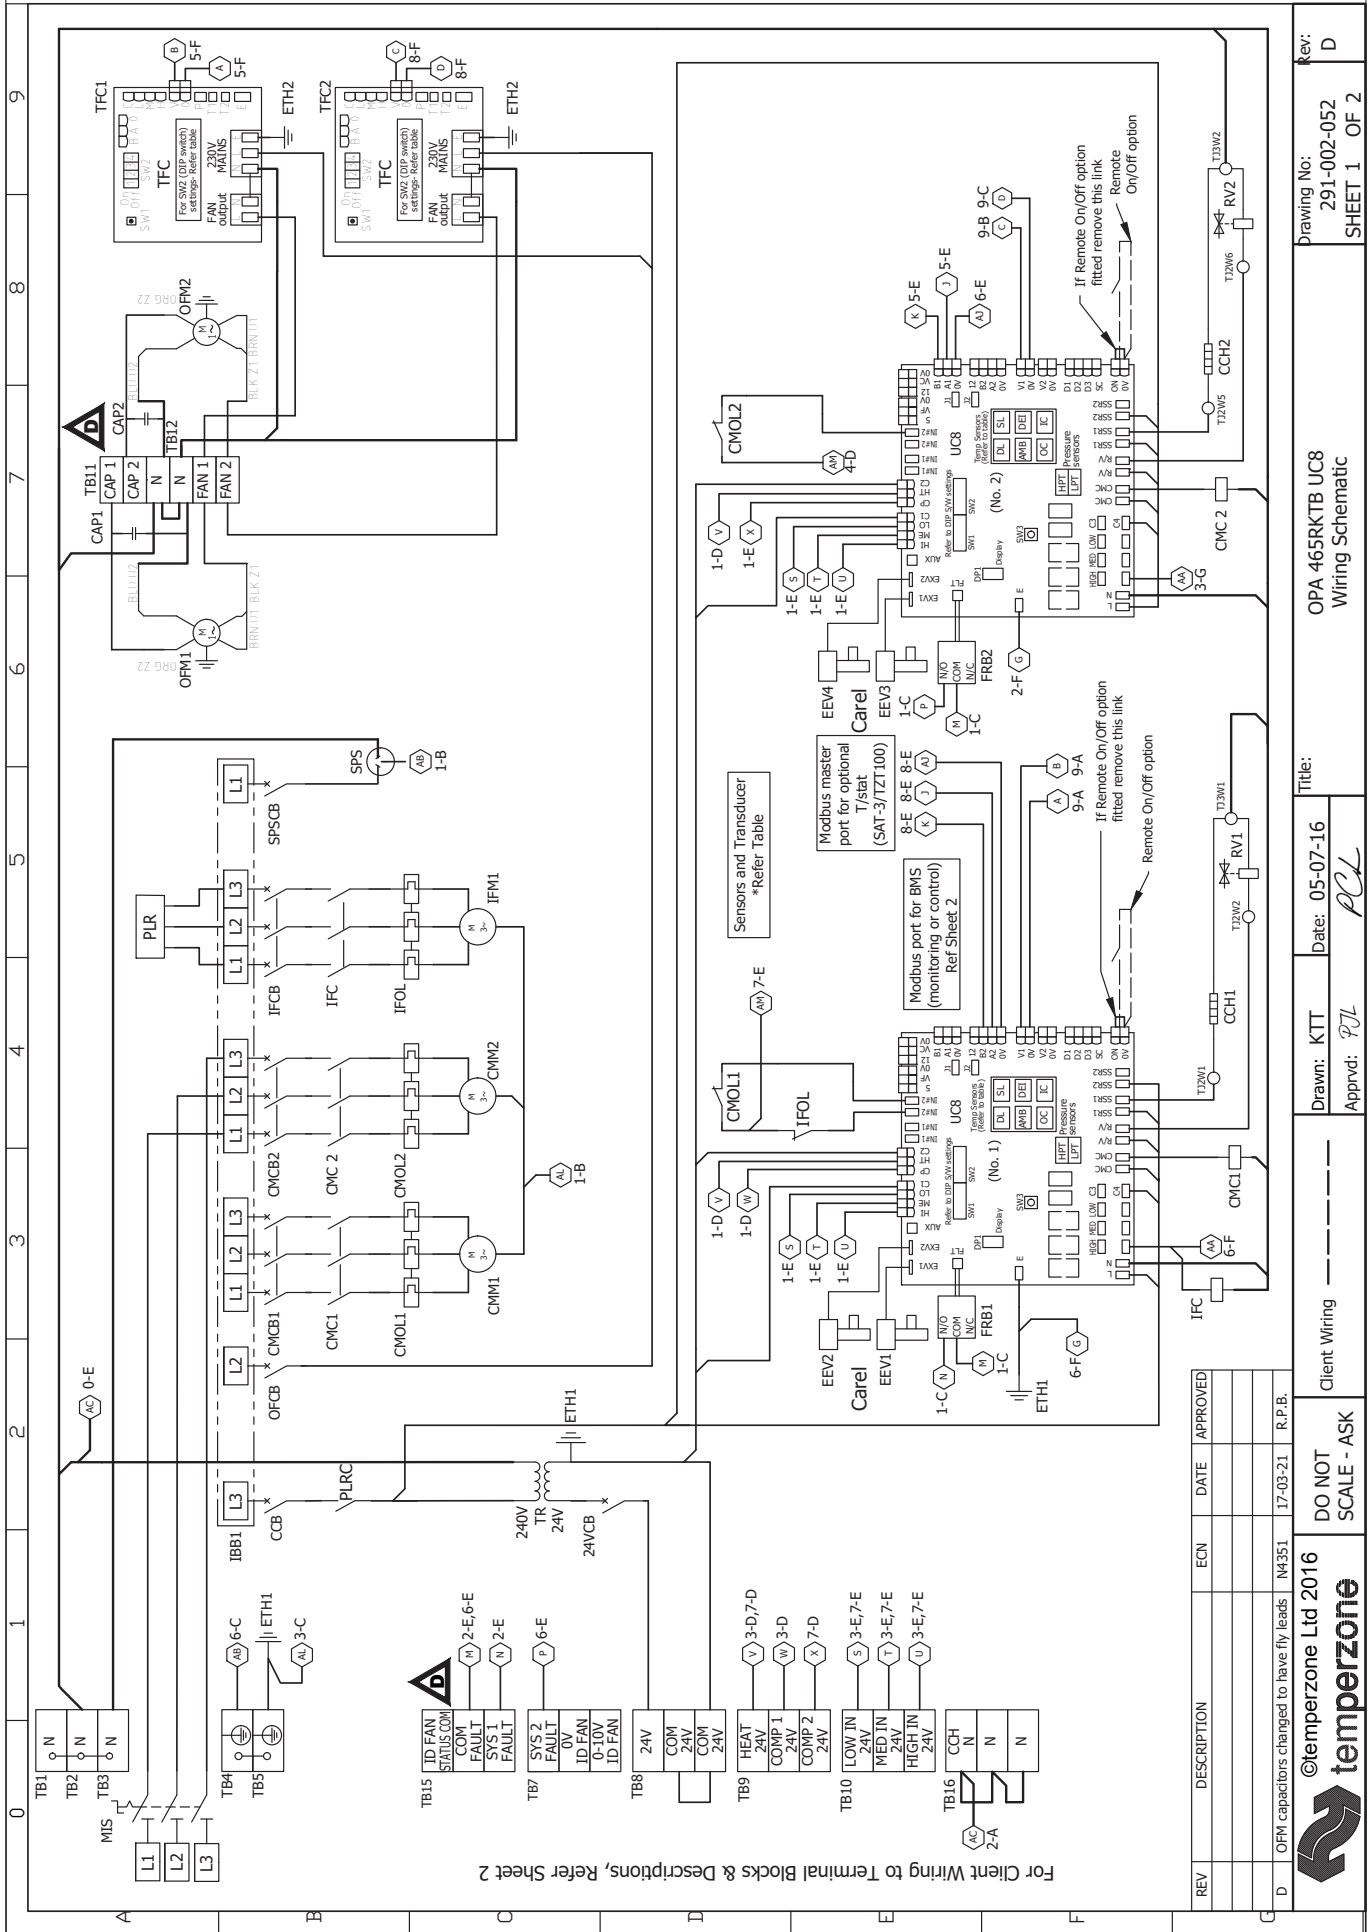

REV	DESCRIPTION	ECN	DATE	APPROVED
D	OPM capacitors changed to have fly leads	N4351	17-03-21	R.P.B.

©temperzone Ltd 2016  
**temperzone**

Client Wiring

DO NOT SCALE - ASK

Drawn: KTT Date: 05-07-16 Title: OPA 465RKT B UC8 Wiring Schematic

Approved: PZL

Rev: 291-002-052 D SHEET 1 OF 2

0	1	2	3	4	5	6	7	8	9																																																																
<p><b>Important Notes:</b></p> <p>1) Crankcase Heater Note 24 Hour power required for control circuit and crankcase heaters</p> <p>2) SAT-3 &amp; TZT 100 Note To connect TZT100 to unit use 2 pair twisted cable - screen grounded. (F/UTP 24G (0.2mm<sup>2</sup>) or thicker recommended)</p> <p>3) Master-slave note When the unit is controlled with a TZT-100 or SAT-3 wall thermostat then the two UC8 controllers must be linked and configured as master and slave. Master DIP switch settings: 11 OFF 12 OFF Slave DIP switch settings: 11 ON 12 OFF</p>	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th>24VCB</th> <th>24 VOLT CIRCUIT BREAKER</th> </tr> <tr> <td>CAP</td> <td>CAPACITOR</td> </tr> <tr> <td>CCB</td> <td>CONTROL CIRCUIT BREAKER</td> </tr> <tr> <td>CCH</td> <td>CRANKCASE HEATER</td> </tr> <tr> <td>CMC</td> <td>COMPRESSOR CONTACTOR</td> </tr> <tr> <td>CMCB</td> <td>COMPRESSOR CIRCUIT BREAKER</td> </tr> <tr> <td>CMM</td> <td>COMPRESSOR MOTOR</td> </tr> <tr> <td>CMOL</td> <td>COMPRESSOR OVERLOAD</td> </tr> <tr> <td>EEV</td> <td>ELECTRONIC EXPANSION VALVE</td> </tr> <tr> <td>ETH</td> <td>EARTH</td> </tr> <tr> <td>FRB</td> <td>FAULT RELAY BOARD</td> </tr> <tr> <td>IFC</td> <td>INDOOR FAN CONTACTOR</td> </tr> <tr> <td>IFCB</td> <td>INDOOR FAN CIRCUIT BREAKER</td> </tr> <tr> <td>IFM</td> <td>INDOOR FAN MOTOR</td> </tr> <tr> <td>IFOL</td> <td>INDOOR FAN OVERLOAD</td> </tr> <tr> <td>IBB</td> <td>INSULATED BUS BAR</td> </tr> <tr> <td>MIS</td> <td>MAIN ISOLATOR SWITCH</td> </tr> <tr> <td>OFGB</td> <td>OUTDOOR FAN CIRCUIT BREAKER</td> </tr> <tr> <td>OFM</td> <td>OUTDOOR FAN MOTOR</td> </tr> <tr> <td>PLRC</td> <td>PHASE LOSS RELAY CONTACT</td> </tr> <tr> <td>PLR</td> <td>PHASE LOSS RELAY</td> </tr> <tr> <td>RV</td> <td>REVERSING VALVE</td> </tr> <tr> <td>SPS</td> <td>SINGLE PHASE SOCKET</td> </tr> <tr> <td>SPSCB</td> <td>SINGLE PHASE SOCKET CIRCUIT BREAKER</td> </tr> <tr> <td>TB</td> <td>TERMINAL BLOCK</td> </tr> <tr> <td>TFC</td> <td>TRAC FAN CONTROLLER</td> </tr> <tr> <td>TJ</td> <td>TERMINAL JOINER</td> </tr> <tr> <td>TR</td> <td>TRANSFORMER</td> </tr> <tr> <td>UC8</td> <td>UNIT CONTROLLER 8</td> </tr> <tr> <td>L1</td> <td>1BB1 L1 LINE SUPPLY</td> </tr> <tr> <td>L2</td> <td>1BB1 L2 LINE SUPPLY</td> </tr> <tr> <td>L3</td> <td>1BB1 L3 LINE SUPPLY</td> </tr> </table>									24VCB	24 VOLT CIRCUIT BREAKER	CAP	CAPACITOR	CCB	CONTROL CIRCUIT BREAKER	CCH	CRANKCASE HEATER	CMC	COMPRESSOR CONTACTOR	CMCB	COMPRESSOR CIRCUIT BREAKER	CMM	COMPRESSOR MOTOR	CMOL	COMPRESSOR OVERLOAD	EEV	ELECTRONIC EXPANSION VALVE	ETH	EARTH	FRB	FAULT RELAY BOARD	IFC	INDOOR FAN CONTACTOR	IFCB	INDOOR FAN CIRCUIT BREAKER	IFM	INDOOR FAN MOTOR	IFOL	INDOOR FAN OVERLOAD	IBB	INSULATED BUS BAR	MIS	MAIN ISOLATOR SWITCH	OFGB	OUTDOOR FAN CIRCUIT BREAKER	OFM	OUTDOOR FAN MOTOR	PLRC	PHASE LOSS RELAY CONTACT	PLR	PHASE LOSS RELAY	RV	REVERSING VALVE	SPS	SINGLE PHASE SOCKET	SPSCB	SINGLE PHASE SOCKET CIRCUIT BREAKER	TB	TERMINAL BLOCK	TFC	TRAC FAN CONTROLLER	TJ	TERMINAL JOINER	TR	TRANSFORMER	UC8	UNIT CONTROLLER 8	L1	1BB1 L1 LINE SUPPLY	L2	1BB1 L2 LINE SUPPLY	L3	1BB1 L3 LINE SUPPLY
24VCB	24 VOLT CIRCUIT BREAKER																																																																								
CAP	CAPACITOR																																																																								
CCB	CONTROL CIRCUIT BREAKER																																																																								
CCH	CRANKCASE HEATER																																																																								
CMC	COMPRESSOR CONTACTOR																																																																								
CMCB	COMPRESSOR CIRCUIT BREAKER																																																																								
CMM	COMPRESSOR MOTOR																																																																								
CMOL	COMPRESSOR OVERLOAD																																																																								
EEV	ELECTRONIC EXPANSION VALVE																																																																								
ETH	EARTH																																																																								
FRB	FAULT RELAY BOARD																																																																								
IFC	INDOOR FAN CONTACTOR																																																																								
IFCB	INDOOR FAN CIRCUIT BREAKER																																																																								
IFM	INDOOR FAN MOTOR																																																																								
IFOL	INDOOR FAN OVERLOAD																																																																								
IBB	INSULATED BUS BAR																																																																								
MIS	MAIN ISOLATOR SWITCH																																																																								
OFGB	OUTDOOR FAN CIRCUIT BREAKER																																																																								
OFM	OUTDOOR FAN MOTOR																																																																								
PLRC	PHASE LOSS RELAY CONTACT																																																																								
PLR	PHASE LOSS RELAY																																																																								
RV	REVERSING VALVE																																																																								
SPS	SINGLE PHASE SOCKET																																																																								
SPSCB	SINGLE PHASE SOCKET CIRCUIT BREAKER																																																																								
TB	TERMINAL BLOCK																																																																								
TFC	TRAC FAN CONTROLLER																																																																								
TJ	TERMINAL JOINER																																																																								
TR	TRANSFORMER																																																																								
UC8	UNIT CONTROLLER 8																																																																								
L1	1BB1 L1 LINE SUPPLY																																																																								
L2	1BB1 L2 LINE SUPPLY																																																																								
L3	1BB1 L3 LINE SUPPLY																																																																								
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">Sensors (S) / Transducers (T)</th> </tr> <tr> <th>Name</th> <th>Type</th> </tr> <tr> <td>DL</td> <td>Discharge Temp S</td> </tr> <tr> <td>SL</td> <td>Suction Temp S</td> </tr> <tr> <td>AMB</td> <td>Ambient Temp S</td> </tr> <tr> <td>DEI</td> <td>De-ice Temp S</td> </tr> <tr> <td>LPT</td> <td>Suction Pressure T</td> </tr> <tr> <td>HPT</td> <td>High Pressure T</td> </tr> </table>										Sensors (S) / Transducers (T)		Name	Type	DL	Discharge Temp S	SL	Suction Temp S	AMB	Ambient Temp S	DEI	De-ice Temp S	LPT	Suction Pressure T	HPT	High Pressure T																																																
Sensors (S) / Transducers (T)																																																																									
Name	Type																																																																								
DL	Discharge Temp S																																																																								
SL	Suction Temp S																																																																								
AMB	Ambient Temp S																																																																								
DEI	De-ice Temp S																																																																								
LPT	Suction Pressure T																																																																								
HPT	High Pressure T																																																																								
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">SAT-3 &amp; TZT100 connection to UC8 terminals</th> </tr> <tr> <th>UC8 terminals(No.1)</th> <th>SAT-3</th> <th>TZT100 Terminals</th> </tr> <tr> <td>12</td> <td>12V</td> <td>24</td> </tr> <tr> <td>B2</td> <td>B</td> <td>B</td> </tr> <tr> <td>A2</td> <td>A</td> <td>A</td> </tr> <tr> <td>0V</td> <td>GND</td> <td>24C</td> </tr> <tr> <td>Screen to 0V</td> <td></td> <td></td> </tr> </table>										SAT-3 & TZT100 connection to UC8 terminals		UC8 terminals(No.1)	SAT-3	TZT100 Terminals	12	12V	24	B2	B	B	A2	A	A	0V	GND	24C	Screen to 0V																																														
SAT-3 & TZT100 connection to UC8 terminals																																																																									
UC8 terminals(No.1)	SAT-3	TZT100 Terminals																																																																							
12	12V	24																																																																							
B2	B	B																																																																							
A2	A	A																																																																							
0V	GND	24C																																																																							
Screen to 0V																																																																									
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">UC8 DIP switch settings (No.1)</th> </tr> <tr> <th>DIP switch</th> <th>On/Off ↓</th> </tr> <tr> <td>1,4,5,7,10</td> <td>On</td> </tr> <tr> <td>All Others Off</td> <td>Off</td> </tr> </table>										UC8 DIP switch settings (No.1)		DIP switch	On/Off ↓	1,4,5,7,10	On	All Others Off	Off																																																								
UC8 DIP switch settings (No.1)																																																																									
DIP switch	On/Off ↓																																																																								
1,4,5,7,10	On																																																																								
All Others Off	Off																																																																								
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">UC8 DIP switch settings (No.2)</th> </tr> <tr> <th>DIP switch</th> <th>On/Off ↓</th> </tr> <tr> <td>1,4,5,7,10</td> <td>On</td> </tr> <tr> <td>All Others Off</td> <td>Off</td> </tr> </table>										UC8 DIP switch settings (No.2)		DIP switch	On/Off ↓	1,4,5,7,10	On	All Others Off	Off																																																								
UC8 DIP switch settings (No.2)																																																																									
DIP switch	On/Off ↓																																																																								
1,4,5,7,10	On																																																																								
All Others Off	Off																																																																								
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">TFC DIP switch settings</th> </tr> <tr> <th>DIP switch</th> <th>On/Off</th> </tr> <tr> <td>1, 2, 3, 4</td> <td>Off</td> </tr> </table>										TFC DIP switch settings		DIP switch	On/Off	1, 2, 3, 4	Off																																																										
TFC DIP switch settings																																																																									
DIP switch	On/Off																																																																								
1, 2, 3, 4	Off																																																																								
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">Client Wiring</th> </tr> <tr> <td style="text-align: center;"> </td> <td style="text-align: center;"> </td> </tr> </table>										Client Wiring																																																															
Client Wiring																																																																									
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">BMS Control</th> </tr> <tr> <td style="text-align: center;"> </td> <td></td> </tr> </table>										BMS Control																																																															
BMS Control																																																																									

REV	DESCRIPTION	ECN	DATE	APPROVED
D	OFM capacitors changed to have fly leads	M4351	17-03-21	R.P.B.

temperzone

©temperzone Ltd 2016  
 DO NOT SCALE - ASK

Client Wiring  
 Drawn: *PJL*    Date: 05-07-16  
 Approved: *PJL*    *PCL*

Drawing No:  
 291-002-052  
 SHEET 2 OF 2

Title:  
 OPA 465RKT8 UC8  
 Wiring Schematic

Rev:  
 D