

ISD 75Q – 470Q


Spring Mounting Kit

Split System Indoor Units

Installation Instructions

Fig. 1

Spring Mount Assembly

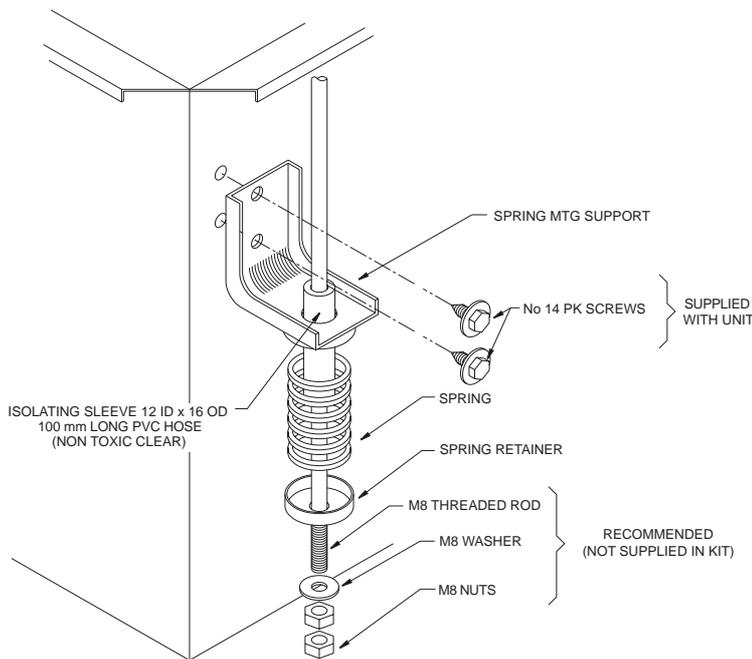

GENERAL

The optional ISD Series Spring Mounting System has been designed to minimise the transfer of vibration from the ISD unit into the building structure.

Check that all items of the kitset are supplied and are in good order.

SPRING MOUNTING KIT

Models	Kit Item No.
No.2: ISD 75Q-300Q	307-161-101
No.3: ISD 390Q, 470Q	307-341-101

Components:

- Four springs
Kit No.2: **white**
Kit No.3: **red**
- Four spring mounting brackets
- Four spring retainers (10 dia. hole)
- Four PVC isolating sleeves

INSTALLATION

When determining the mounting position consideration must be given to adequate access within the ceiling space. Refer to the separate Installation & Maintenance pamphlet relevant to each unit for clearance details.

Locate the appropriate number of mounting hole centres (refer figure 2) and fit fixing rods (not supplied) to the supporting ceiling.


Lift the unit up to mate with the fixings. Assemble the spring mounting components as shown in figures 1 or 2 as appropriate.

Refer to the separate Installation & Maintenance pamphlet relevant to each unit for drainage, electrical and refrigeration work required to complete the installation.

Fig. 2

Mounting Centre Dimensions (mm)

MODEL	A	B
ISD 75Q	595	690
ISD 85Q	595	690
ISD 101Q,	595	865
ISD 127Q	595	1015
ISD 146QB	595	1150
ISD 150Q	595	1150
ISD 180Q	595	1494
ISD 181Q	595	1285
ISD 220Q	595	1285
ISD 250Q	688	1518
ISD 300Q	688	1518
ISD 390Q	688	1573
ISD 470Q	688	1914

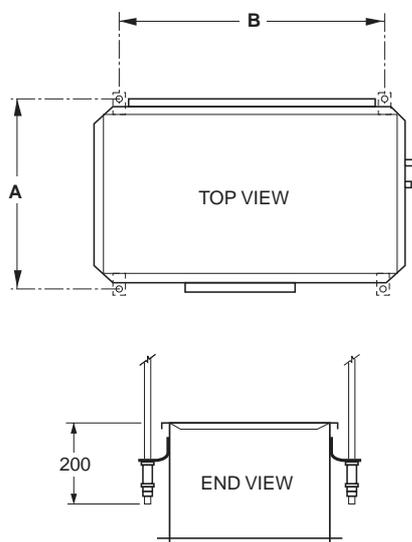

This pamphlet replaces the previous issue no. 1938 dated 01/01. ISD 470Q added.

NOTE

The manufacturer reserves the right to make changes in specifications at any time without notice or obligation. Certified data is available on request.